

4/8/24

DATE

1

MARK

GENERAL REVISION

**REVISION DESCRIPTION** 

HdB

BY

Toll Free: 800.242.1509

Online: www.terrehill.com

# SUBMITTAL **FOR REVIEW** COMMENTS **AND APPROVAL**

THE UNDERSIGNED HEREBY APPROVES THE ATTACHED (9) PAGES.

CUSTOMER DATE TERRE HILL OR NON-TERRE HILL ROJECT No · SEQ. No.: DATE 240348-TA XXX 21/2/-2024 DESIGNED XXX HdB HECKED ROVED XXX XXX SHEET NO .: OF 9

		BILL OF MATERIALS			
		C:\Users\hdebruijn\Desktop\Terre Arch Projects\2400348-TA-Design Blenz Penngrove, Sale	m County, NJ\[BOM-TA 26-DISPE	ISARY-Rev-2.xlsx]BOM	
PIECE	QTY	DESCRIPTION	S	IZE	HEIGHT
ALL		ARCH ASSEMBLY MATRIX	NUMBER OF 8 Ft ROWS = 3	NUMBER OF 19 Ft COLUMS = 1	
			NUMBER OF 8 Ft ROWS = 13	NUMBER OF 19 Ft COLUMS = 1	
			NUMBER OF 8 Ft ROWS = 2	NUMBER OF 19 Ft COLUMS = 1	
	18	TERRE ARCH 26	7'-11 ¾	X 19-11 ½	2'-10"
	11	CAPPING SLAB	0'-4'' X	9'-11 ¾"	2'-10"
	1	SPECIAL CAPPING SLAB WITH PIPE OPENING	0'-4'' X	9'-11 ¾"	2'-10"
	1	EJIW#41600389, OR FRAME & COVER	Ø	24"	
	3 PC	ANTI-SCOUR MAT (TEN CATE GFF 58600 WHITE-CC-HONEYCOMB FILTER	6'8" X 15' (11.	1 SQFT PER PC)	N/A
	2 PC	EROSION GRID (TENSAR BX1200)	13' x 22' (31.	8 SQFT PER PC)	N/A
В	1	1 OPEN SIDED DISTRIBUTION MANIFOLD, ONE 18" PIPE END, TWO 12" PIPE SIDE ENTRIES			2'-10"
	24	CAPPING SLAB STRAP	10½	2 X 3"	N/A
	613 Ft	CONSEAL CS102-B(1½") + 10%	N	I/A	N/A


<u>STRUCTURE WEIGHTS</u> HEAVIEST PICK WEIGHT = 13,500 LBS ARCH = 13,500 LBS EACH MANIFOLD = 12,500 LBS MAX CAPPING SLAB = 1500 LBS EACH


\* ALL MATERIALS PROVIDED BY , INSTALLED BY CONTRACTOR UNLESS NOTED OTHERWISE

						TERRE ARCH <sup>™</sup>
	2	4/10/2024	GENERAL REVISION	HdB	CONCRETE PRODUCTS	05P10 Patent #7,736,747
	1	4/8/24	GENERAL REVISION	HdB	Toll Free: 800.242.1509 Online: www.terrehill.com	
MA	٩RK	DATE	REVISION DESCRIPTION	BY	Onine. www.terrenni.com	

TERRE ARCH

	PROJECT No.: \$	SEQ. No.:	DATE:		
T400	240348-TA	XXX	21/2/-2024		
TA26	DESIGNED:	DRAV			
JECT	XXX		HdB		
JECT	CHECKED:	APPR	APPROVED:		
	XXX		XXX		
	SHEET NO .:	2 0	- 0		

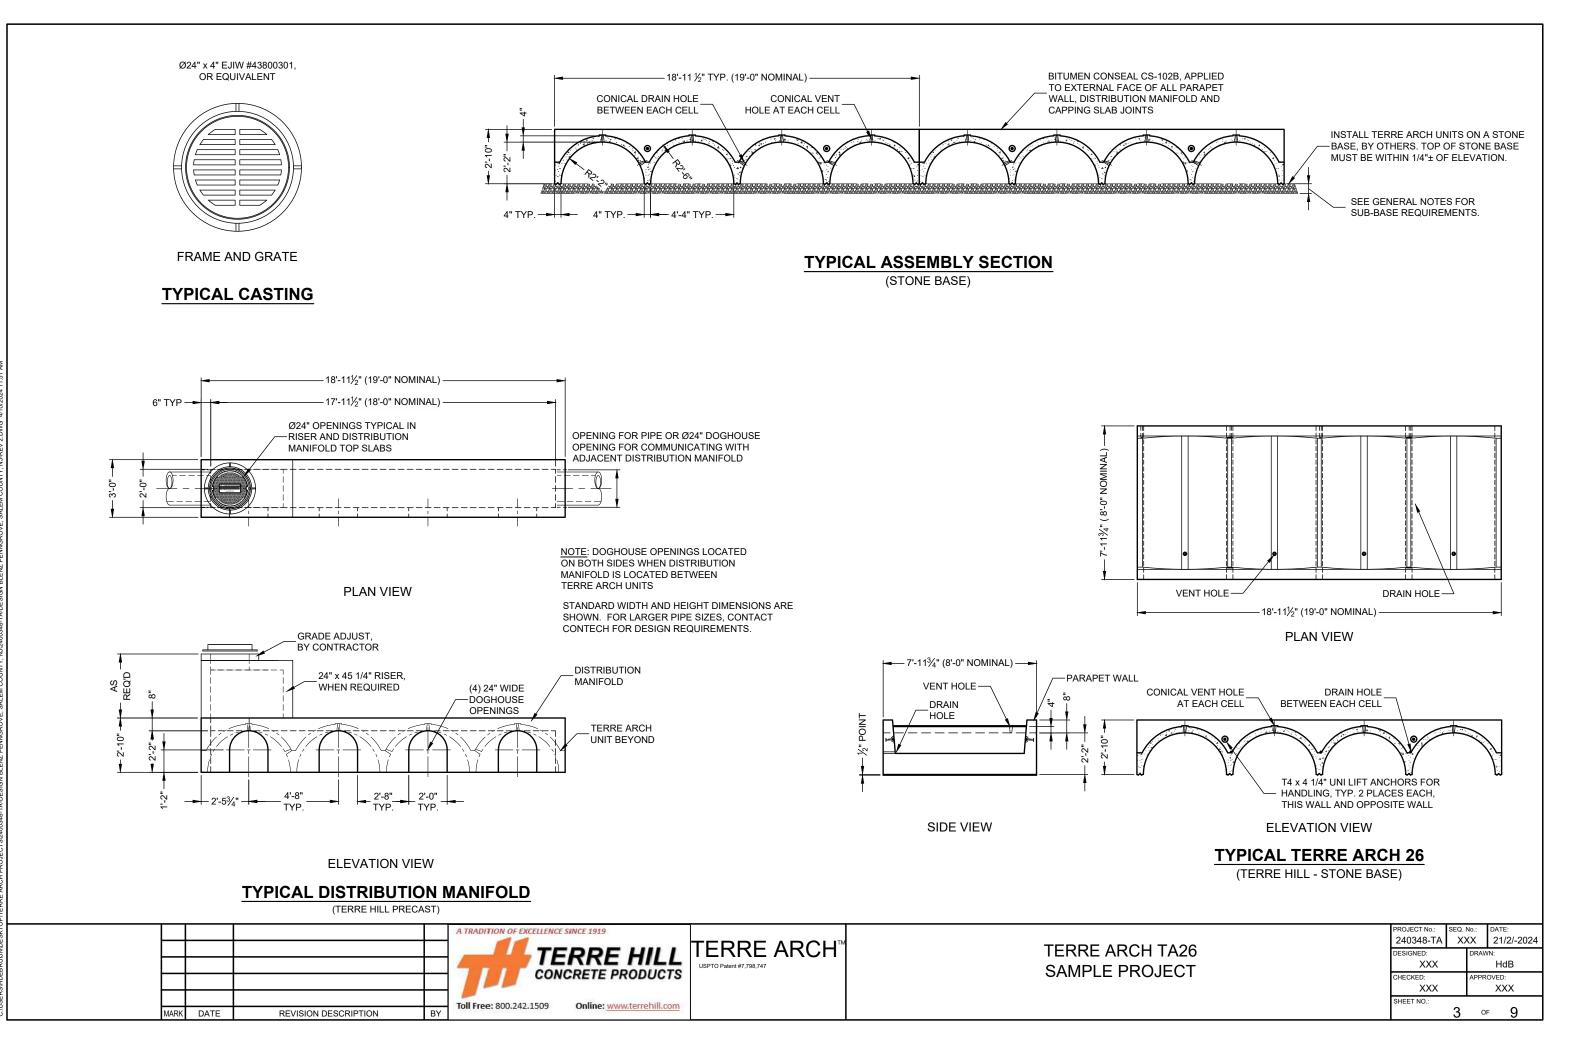

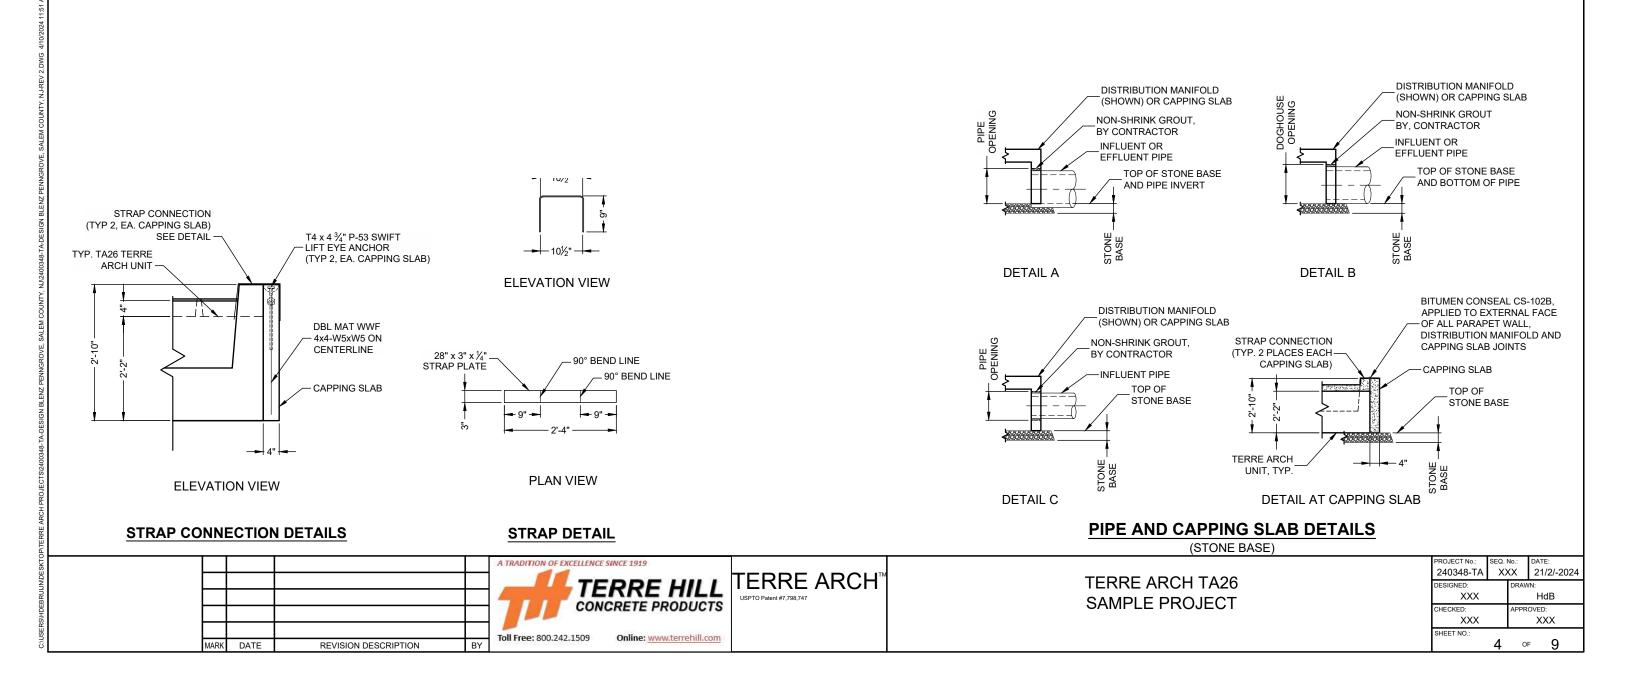

# TERRE ARCH PLAN NOTES

TERRE ARCH, USPTO PATENT # 7,798,747 stormwater capture module, underground storage system manufactured by Terre Hill Concrete Products www.terrehill.com

Terre Hill Concrete Products shall submit shop drawings and such other information requested by Engineer to verify Performance and Design Specifications.

### Terre Arch Design Specifications

Cement conforms to ASTM C150 (type III) CONCRETE E'C= 6 000 PSI AT 28 DAYS Self-compacting Concrete conforms to ASTM C1611 Air-entrained Concrete conforms to ASTM C 260 Aggregate conforms to ASTM C-33 #57 OR #67 coarse aggregate and fiber reinforcing.

Deformed steel reinforcing conforms to ASTM A615 GRADE 60. Welded wire fabric conforms to ASTM A-185 Deformed welded wire fabric of equal size or equal size ASTM A-497 may be substituted for smooth welded wire fabric and shall conform to ASTM A-1064. Epoxy Coated Steel Reinforcement Bars shall conform to ASTM A-775 Welded Wire shall conform to ASTM A-884


ConSeal Butyl Rubber Sealant (CS-102)


- Shall meet or exceed the hydrostatic performance requirement set forth in ASTM C-990, section 10.1 Shall meet or exceed all of the requirements of Federal Specification SS-S-210 (210-A0, AASHTO M-198B, and ASTM C-990-91 ConSeal Polyolefin Backed Exterior Joint Wrap (CS-212)
- Shall meet or exceed ASTM E-1745, C877,C-990, Federal Specificatio SS-S210 (210-A), AASHTO M-198B

UNI LIFT ANCHORS TYPICAL FOR HANDLING; MANUFACTURER SHALL LOAN THE LIFTING HARDWARE TO CONTRACTOR, WHICH SHALL BE THE PROPERTY OF MANUFACTURER.

PA THREADED INSERTS ARE MANUFACTURED BY PENNSYLVANIA INSERT CORPORATION.

FRAME AND COVER LID SHALL MEET OR EXCEED ASTM A 48, CLASS 35 GRAY ASTM A 536, GHRADE 60-40-18, DUCTILE IRON UNLESS OTHERWISE INDICATED: MARKED "TERRE HILL STORMWATER SYSTEMS"



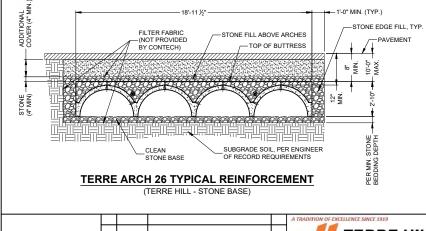

## TERRE ARCH PERFORMANCE SPECIFICATIONS

HS-25 LOAD RATING ON THE CROWN OF THE ARCH; (12" PERIMETER STONE FILL REQUIRED)

ONE FOOT MINIMUM (TOP OF ARCH) COVER OR FILL: MAXIMUM COVER IS 10 FEET

TERRE ARCH (TA-26) NOMINAL DIMENSIONS; 152 SQUARE FEET (8/X19) INFILTRATION SURFACE PER STRUCTURE; 236 CUBIC FEET OF DYNAMIC STORAGE CAVITY

TERRE ARCH (TA-48) NOMINAL DIMENSIONS: 160 SQUARE FEET (8'X20') INFILTRATION SURFACE PER STRUCTURE; 480 CUBIC FEET OF DYNAMIC STORAGE CAVITY

TA-26 13 500 LBS: 3 STRUCTURES PER TRUCK

TA48 18,000 LBS. 2 STRUCTURES PER TRUCK

VENTILATION AND DRAINING ORIFICES IN TOP AND VALLEY AREAS OF TERRE ARCH.

DISTRIBUTION MANIFOLDS ARE REQUIRED WHERE INLET/OUTLET PIPES ARE LOCATED.

RISERS WITH ACCESS OPENINGS TO FINISHED GRADE MAY BE REQUIRED FOR SYSTEM ACCESS.

END CAPS WITH CAPPING STRAPS MAY BE REQUIRED.

#### TERRE ARCH INSTALLATION INSTRUCTIONS

EXCAVATION, COMPACTED STONE BASE, BACKFILLING, GRADING, DEWATERING AND SHORING OF EXCAVATION IN ACCORDANCE WITH APPROVED DRAWINGS, PROJECT SPECIFICATIONS APPROVED BY ENGINEER OF RECORD AND IN ACCORDANCE WITH OSHA REQUIREMENTS BY OTHERS.

UNDERLYING SOIL AND SUB-GRADE MATERIAL SHALL HAVE DESIGN LOADING OF NOT LESS THAN 3,000 POUNDS PER SQUARE FOOT (PSF), AS ESTABLISHED BY PROJECT ENGINEER: (MINIMUM STONE BED SHALL BE 10" OF #5 STONE, TOPPED WITH 2" OF #8 STONE) | EVEL TOLERANCE +/- 3".

TERRE ARCH STRUCTURES SHALL BE OFF, OADED FROM TRUCK WITH CRANE AND PLACED INTO POSITION USING UNLI JET ANCHORS TYPICAL FOR HANDLING. MANUFACTURER SHALL LOAN THEIR LIFTING HARDWARE TO THE CONTRACTOR, WHICH IS SHIPPED WITH THE FIRST DELIVERY TRUCK.

EROSION MAT TO BE TENSAR BX-1200 BIAXIAL GEOGRID: OR EQUAL AT ALL INLET PIPES.

ANTI-SCOUR MAT TO BE TENCATE NICOLON, OR EQUAL AT ALL INLET PIPES.

USE FILTER FABRIC OR GEOTEXTILE TO PREVENT WHERE SILT MIGRATION INTO THE STONE AND DYNAMIC VOID SPACE IS POSSIBLE.

PLACE CONSEAL ON THE JOINTS OF PRECAST COMPONENTS TO PREVENT MIGRATION OF PARTICULATES INTO THE JOINT SPACES.

PRIOR TO ALLOWING TOP LOADING ALL PERIMETER EXCAVATION CAVITIES SHALL BE FILLED WITH STONE TO PROVIDE LATERAL SUPPORT TO THE TOP LEVEL OF THE PARAPET OF THE TERRE ARCH.

AFTER A MINIMUM OF FIGHT (8) INCHES OF SYSTEM COVER IS PRESENT. SMALL DOZERS (D4 OR SMALLER) MAY BE USED TO REACH FINISH GRADE

USE LIGHT VIBRITOREY EQUIPMENT TO STABILIZE THE TOP STONE AND SETTLE THE ARCHES INTO THE SUB-BASE.

FINALIZE COVERING THE SYSTEM WITH SPECIFIED STONE TOP LOADING AND COVER WITH FILTER FABRIC TO PREVENT MIGRATION OF FINES INTO THE STONE VOIDS.

PLACE ADDITIONAL GRADING MATERIALS AS REQUIRED.

CONTRACTOR SHALL REMOVE ALL FOREIGN MATERIAL(S) FROM THE TERRE ARCH DETENTION CAVITY.

# PRODUCT SUBSTITUTION PROCEDURES

NO UNDERGROUND STORMWATER STORAGE SYSTEM SHALL BE APPROVED AS AN EQUIVALENT SUBSTITUTION FOR A TERRE ARCH SYSTEM UNLESS THE ENGINEER OF RECORD SHALL RECEIVE AND APPROVE DRAWINGS AND SPECIFICATIONS STAMPED AND SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE STATE WHEREIN THE PROJECT IS LOCATED SHOWING THE FOLLOWING:


PROJECT SPECIFIC SIZING CALCULATIONS CLEARLY SHOWING THAT THE UNIT MEETS OR EXCEEDS THE PERFORMANCE AND DESIGN SPECIFICATIONS OF THE TERRE ARCH

# MAINTENANCE PROCEDURES


- WHEN A STORMWATER TREATMENT SYSTEM IS PLACED IN FRONT OF THE TERRE ARCH SYSTEM NO CLEAN OUT OR MAINTENANCE IS ANTICIPATED, AS LONG AS THE STORMWATER TREATMENT SYSTEM IS PROPERLY MAINTAINED INSPECTION CAN BE ACCOMPLISHED FROM GRADE WITH PROPER EQUIPMENT BY ENTRY THROUGH THE ACCESS OPENING(S)
- SYSTEM SHALL CONTAIN SUFFICIENT DISTRIBUTION MANIFOLDS TO ALLOW ENTRY FOR INSPECTION AND MAINTENANCE INTO EACH TERRE ARCH

SUBJECT TO CHANGE WITHOUT NOTICE.

F						
Ĕ		AT	RADITION OF EXCELLENCE SINCE 1919		0. No.: DAT	
NDE:				240348-TA	_	1/2/-2024
nn		- 1		DESIGNED: XXX	DRAWN:	HdB
EBR			UNITO PAGENT #7.747.747 SAMPLE PROJECT	CHECKED:	APPROVE	
SH		/		XXX		XXX
SER				SHEET NO .:		
3	MARK DATE REVISION DESCRIPTION	BY	Free: 800.242.1509 Online: www.terrehill.com	5	OF	9

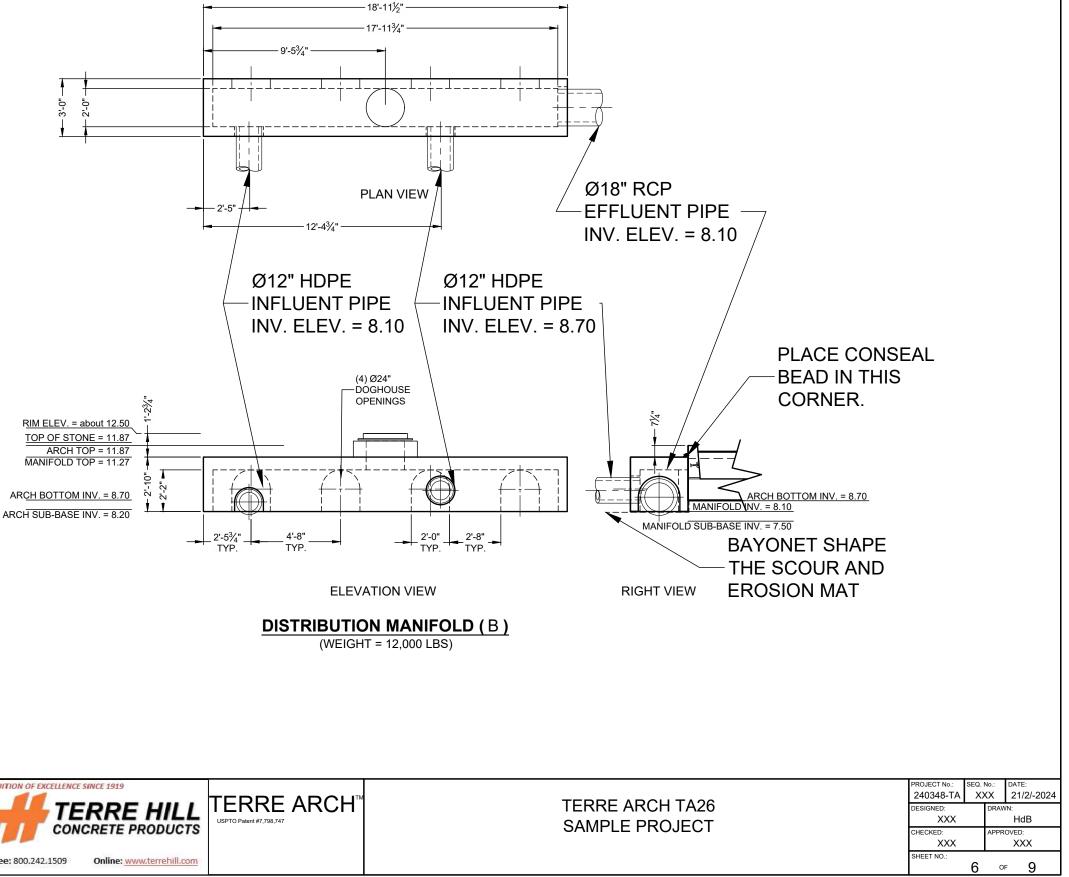



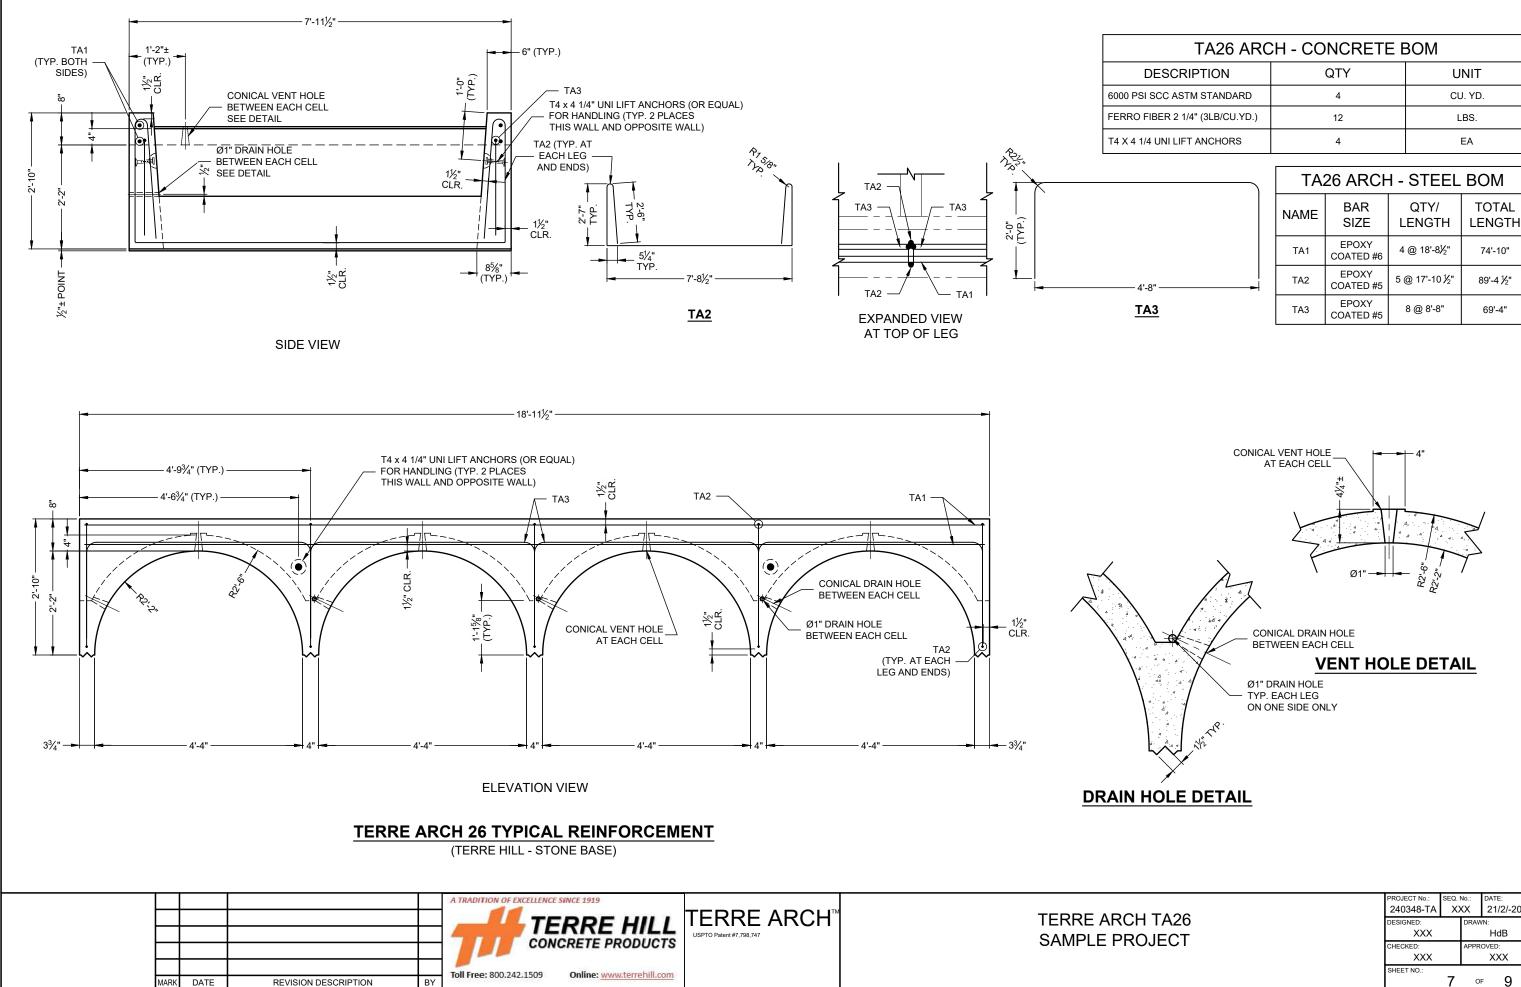


TA26 ARCH - CONCRETE BOM					
DESCRIPTION	QTY	UNIT			
SCC ASTM STANDARD	4	CU. YD.			
IBER 2 1/4" (3LB/CU.YD.)	12	LBS.			
UNI LIFT ANCHORS	4	EA			


TA	26 ARCH	I - STEEL	BOM
NAME	BAR SIZE	QTY/ TOTAL LENGTH LENGTH	
TA1	EPOXY COATED #6	4 @ 18'-8½"	74'-10"
TA2	EPOXY COATED #5	5 @ 17'-10 ½"	89'-4 ½"
TA3	EPOXY COATED #5	8 @ 8'-8"	69'-4"

	PROJECT No.: 240348-TA	SEQ. I		DATE: 21/2	2/-2024
I TA26 DJECT	DESIGNED: XXX		DRAWN: HdB		
JECT	CHECKED: XXX	APPROVED: XXX			
	SHEET NO .:	7	OF	-	a

TA48 CAPPING SLAB - CONCRETE BOM							
DESCRIPTION	QTY	UNIT					
6000 PSI SCC ASTM STANDARD	8	CU. YD.					
T4 X 4 3/4" P-53 SWIFT LIFT EYE	2	EA					

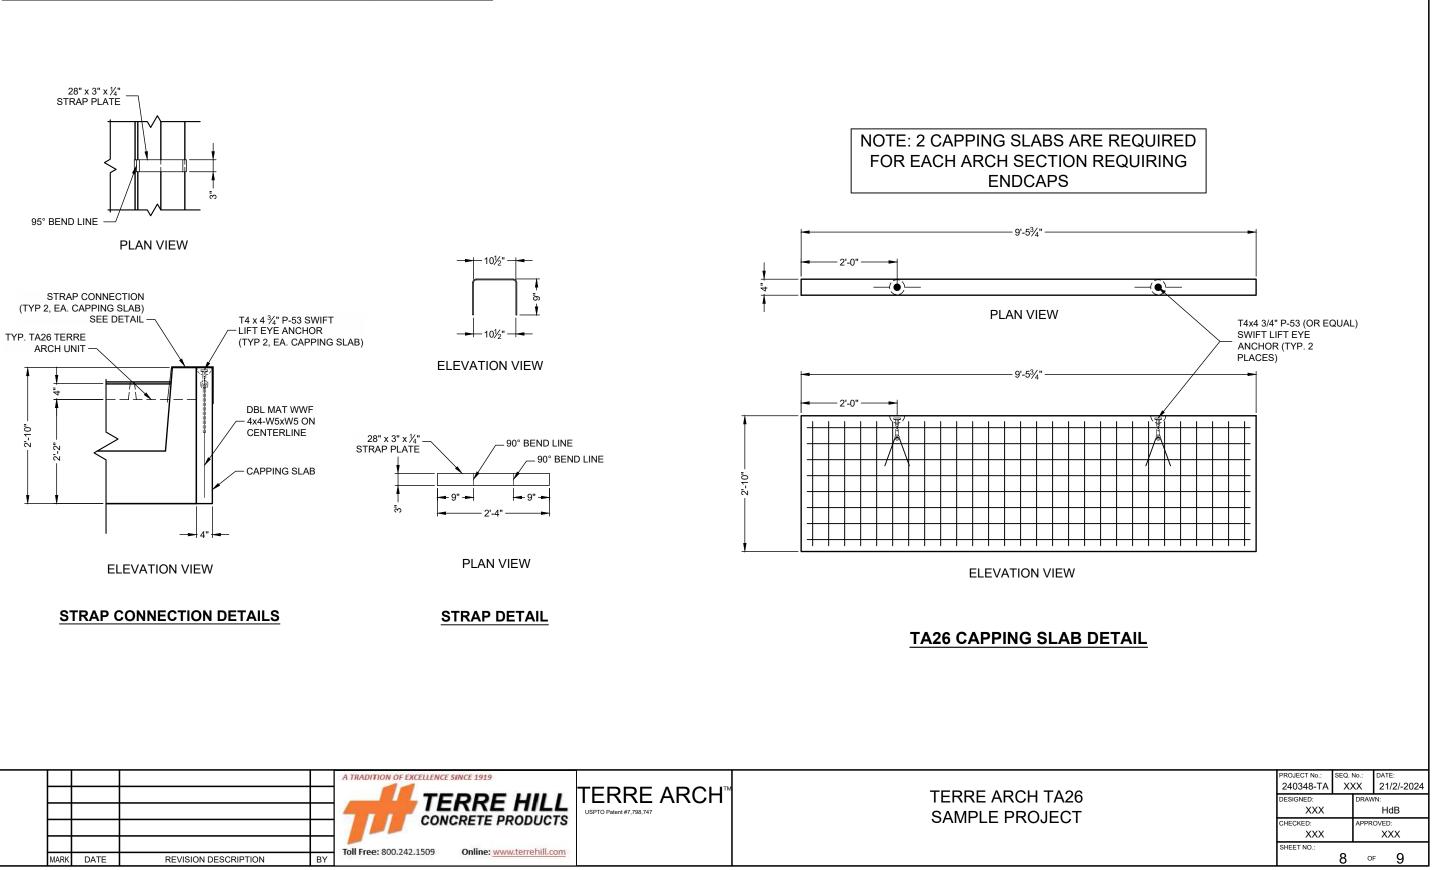



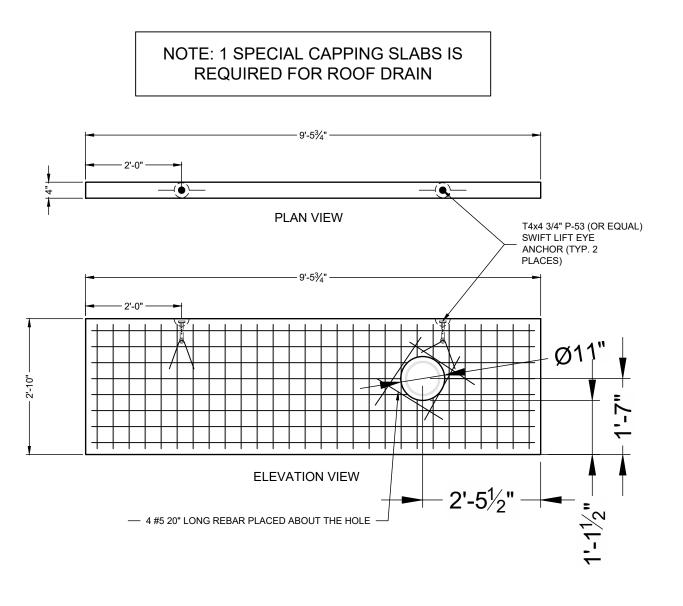



	PROJECT No.: SEQ. No.: 240348-TA XXX					
I TA26 DJECT	DESIGNED: XXX		DRAWN: HdB			
52C1	CHECKED: AI		APPR	PPROVED: XXX		
	SHEET NO .:	9	OF	-	9	